


Application description combined heat and power plant – CHP*

Sketch & function CHP

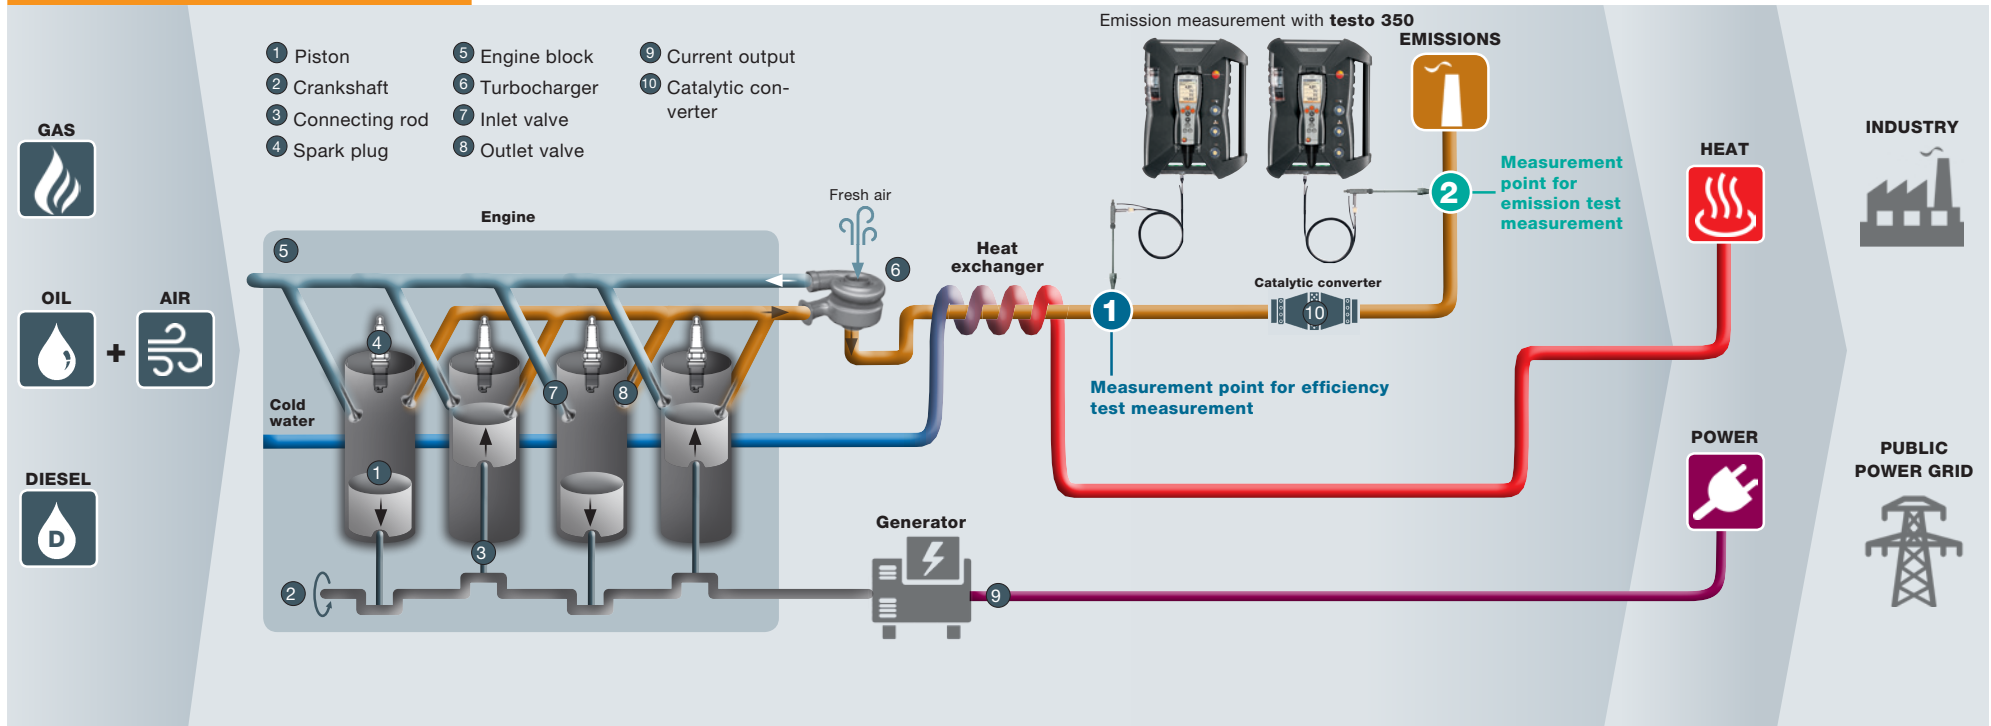

Typical combustion process in a CHP engine

- I. The fuel/air mixture is **drawn** in by way of the inlet valve.
- II. The mixture is **compressed** and heated.
- III. **Ignition** of the fuel-air mixture (by a spark plug in richburn engines, by self-ignition in diesel engines).
- IV. This causes a **rotary motion** of the crankshaft. The rotary motion is converted into electricity by the generator.
- V. Burnt up exhaust gas is **ejected** through the open outlet valve.
- VI. The **turbocharger**, driven by the exhaust gas, compresses the combustion air that is supplied to the engine. As a result, engine output is increased while fuel consumption is reduced and emission levels are improved.
- VII. The **heat exchanger** utilises the heat stored in the exhaust gas to operate the heating system or is used as **process heat**.

* Counts in general for all engine applications

Application description combined heat and power plant – CHP*

Measurement

Measurement point ① efficiency test measurement

Measurement point before the catalytic converter
(after the turbocharger)

Why are measurements taken?

- Checking and inspecting engine efficiency
- Error detection/analysis of the engine's operating conditions, including engine control system
- Optimum adjustment of the engine in order to save fuel → better efficiency
- Correct adjustment of the relations between ignition timing, excess air etc. of the engine

Typical exhaust gas properties:

- **Temperature:** approx. +650 °C
- **Overpressure:** up to approx. 100 mbar (dependent on turbocharger and catalytic converter)

Typical measurement values with testo 350**:

Meas. parameter	Natural gas	Landfill gas	Oil
O ₂	8 %	5 to 6 %	8 to 10 %
NO	100 ... 300 ppm	100 ... 500 ppm	800 ... 1000 ppm
NO ₂	30 ... 60 ppm	90 ... 110 ppm	10 ... 20 ppm
CO	20 ... 40 ppm	350 ... 450 ppm	450 ... 550 ppm
CO ₂	10 %	13 %	7 to 8 %
SO ₂		30 ppm	30 to 50 ppm

** lean burn engine

Practical information:

Excess air, fuel pressure, the timing of the engine or the ambient temperature or humidity can have significant impact on the emission. Must consider all when tuning or adjusting engines.



Measurement point ② emission test measurement

Measurement point after the catalytic converter
(at the end of the exhaust pipe)

Why are measurements taken?

- Testing catalytic converter efficiency
- Checking emission limits (dependent on national emission standards, e.g. TI Air ("TA-Luft"))

Typical exhaust gas properties:

- **Temperature:** approx. +250 °C
- **Overpressure:** no high overpressure in the flue gas
- **NO_x value:** approx. 480 mg/m³ (guideline, since slightly below 500 mg/m³ limit value)

Typical measurement values with testo 350:

Meas. parameter	Type of engine	Limit values
CO	Natural gas	650 mg/m ³
NO + NO ₂	Compression ignition (Diesel) < 3 MW	4000 mg/m ³
NO + NO ₂	Compression ignition (Diesel) > 3 MW	2000 mg/m ³
NO + NO ₂	Other 4-stroke (gas engines)	500 mg/m ³
NO + NO ₂	Other 2-stroke (gas engines)	800 mg/m ³
O ₂	Reference value	5 vol. %
SO ₂	IAW DIN 51603 standard	

Measurement aperture

- Short, welded-on connecting piece with external thread
- Bore hole with internal thread, directly integrated into the exhaust pipe
- Various flange solutions



Information:

These measurement locations can often only be reached using a ladder, platform or similar.




* Counts in general for all engine applications

Application description combined heat and power plant – CHP*

Theoretical background 1

Development of emissions based on λ values

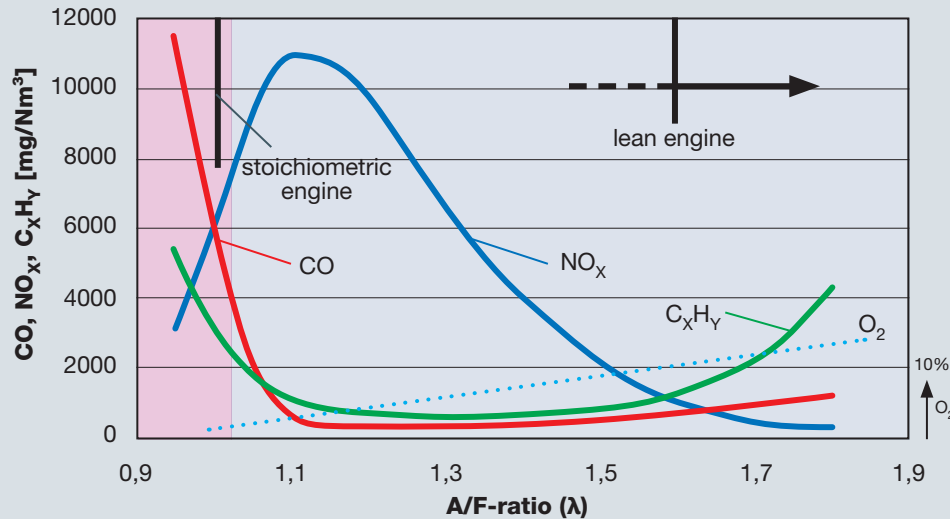

In general:

The curve on the combustion chart shifts, depending on the relation between air and fuel ratio

NO_x:

NO_x = NO + NO₂ → measure NO_x separately
 - NO₂ components can fluctuate widely
 - Consisting of fuel NO_x and thermal NO_x
 - Highest NO_x value = highest mechanical efficiency

C_xH_y:

C_xH_y + O₂ → CO₂ + H₂O (combustion equation)

* Counts in general for all engine applications

Rich engines ($\lambda \leq 1$)

Characteristics:

- Engines with air deficiency (Lambda = 1): Fuel is therefore not used efficiently
- Typical applications: Compressor stations e.g. gas transportation (comparable to gasoline engine in cars)
- Typical working range: λ -0.85 to 0.95

Advantage and disadvantage for rich engine:

- + High performance density
- + Initial cost is lower than lean burn engine
- + Secure operation
- High fuel consumption
- High emissions (if not controlled)
- Not suitable for use with bio-gas

NO_x (nitrogen oxides):

NO_x ≤ NO_x max.:
 low NO_x component due to incompletely burned or unburned fuel (HC)
 → no max. temperature development (so less thermal NO_x is generated)

C_xH_y or HC (hydrocarbon, e.g. methane):

Due to the lack of oxygen, not all fuel (HC) is burnt up
 → high C_xH_y value

CO (carbon monoxide):

Oxygen deficiency in the combustion process leads to the inability of all CO molecules to be converted into CO₂. As a result, fuel leaves the engine incompletely burned or unburned.
 → leads to high fuel consumption (HC slip)

Lean engines ($\lambda > 1$)

Characteristics:

- Engines with excess air (lean engines)
 → Fuel is used efficiently
- Typical applications: Power supply for hospitals, government buildings, server buildings, sewage plants, mining
- Typical working range: λ -1.05 to 1.3

Advantage and disadvantage for lean engine:

- + Suitable for use with bio-gas
- + High fuel efficiency
- + Low in emissions
- Low effectivity

NO_x (nitrogen oxides):

NO_x > NO_x max.: An elevated O₂ level leads to a lowering of the combustion chamber temperature, therefore low NO_x percentage (lower levels of thermal NO_x)

C_xH_y or HC (hydrocarbon, e.g. methane):

If excess oxygen levels are too high, the combustion temperature is lowered such that the flame temperature is no longer sufficient to burn up all of the fuel (HC)
 → Increased C_xH_y value


CO (carbon monoxide):

Excess oxygen in the combustion process leads to the ability of the CO molecules to combine with O₂ to CO₂
 → Oxygen is left over

Application description combined heat and power plant – CHP*

Theoretical background 2

Correctly configuring the engine to prevent “knocking” and “spark failures” of the engine.

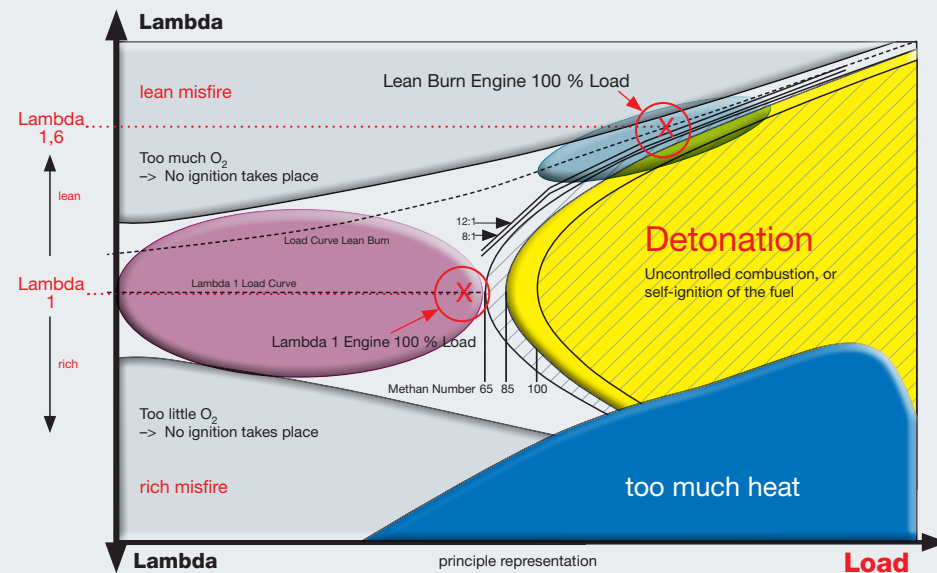

Setting options for rich engines

Incorrect configuration of the fuel/air mixture:

Depending on the load point and on the specifications provided by the engine manufacturers or the national emission regulations

High HC and/or NO_x values after TWC (3-way catalytic converter):

-> Measurement before/after TWC, see high NO_x values before TWC

High NO_x levels before TWC:

-> High temperatures in the combustion chamber: Set ignition in “earlier” direction and check Lambda probe

High NO_x or HC values before TWC:

-> Cylinder error caused by misfire: burnable gas composition, ambient temperature and humidity, temperature and pressure of the burnable gas, inlet air temperature after the turbocharger etc.

Setting options for lean engines

High NO_x levels before Selective Catalytic Reduction (SCR):

-> Measurement before/after SCR, see high NO_x values before SCR

High NO_x levels before SCR:

-> Ignition point too early
-> Shift ignition point towards late

Too low methane count (often fluctuation with bio-gas):

-> low ignition temperature
-> premature ignition

Setting options for knocking:

-> incandescent burnup (combustion and oil residue) on burner walls

-> premature ignition

-> new engines have knocking sensors

-> Stone impact, rattling chains etc. can lead to error signals from the knocking sensor (=acoustic)



CAUTION:

"Ignition point too early" leads to knocking, "ignition point too late" leads to spark failures -> precise adjustment only possible with measuring instrumentation. "Guideline values" can also have an effect on other parameters (e.g. lubricants, temperatures etc.), which can lead to increased wear.

Rich engine

Secure engine operation

- Large engine adjustment corridor
- "Lean misfire" or "rich misfire"
- In rich combustion engines, this is unusual

Lean engine

Efficient operation

- Exact adjustment of the engine using measuring instrument (testo 350) necessary
- Small engine adjustment corridor
- If engine incorrectly adjusted:**
 - "Lean misfire" or "knocking risk"

Why a catalytic converter?

General

Principle:

Catalytic converters increase the speed of a chem. reaction by lowering the activation energy. Catalytic converters are not used up themselves.



Rich engine

3-way catalytic converter (TWC):

- Controlled catalytic converter: is controlled by a λ probe (sensor which analyses the air/fuel ratio in the flue gas of a combustion process)
- Reduces pollutants by up to 90%: CO and NO_x and HC
- Optimum working range: λ~0.98 to 0.998

Lean engine

Oxidizing catalytic converter:

Reduces CO and HC emissions; NO_x emissions, however, are not reduced.

SCR (Selective Catalytic Reduction) = DeNO_x:

NO_x reduction in exhaust gases

* Counts in general for all engine applications